


NOTES:

1. EACH STRUCTURE SHALL HAVE AN INDIVIDUAL LATERAL FROM THE BUILDING TO THE COLLECTOR MAIN.
2. SEWER LATERAL SHALL BE A MINIMUM 4" DIAMETER UNLESS OTHERWISE APPROVED BY THE BUILDING INSPECTOR, AND OF THE FOLLOWING MATERIAL:
 - 2.1. PVC, SDR 35 (ASTM D-3034)
 - 2.2. HDPE SDR 17 (TRENCHLESS CONSTRUCTION ONLY) OR APPROVED EQUAL.
3. MINIMUM SLOPE OF LATERAL 1/4" PER FT. UNLESS OTHERWISE SPECIFICALLY APPROVED BY THE BUILDING INSPECTOR, IN WHICH CASE THE SLOPE SHALL BE NO LESS THAN 1/8" PER FT.
4. BACKFILL LATERAL TRENCH PER "TRENCH DETAIL" AND STD. DWG. NO. 210.



TRENCH DETAIL

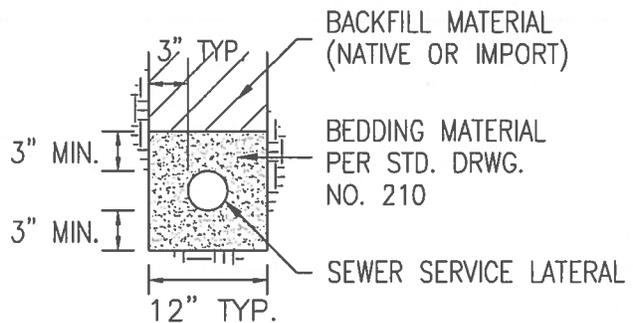

DESIGN AND CONSTRUCTION STANDARDS
SEWER SERVICE LATERAL
 (PROPERTY LINE TO BUILDING)

Tim Eriksen
 TIM ERIKSEN, PUBLIC WORKS DIRECTOR / CITY ENGINEER

DRAWING NO.

213

DRAWN BY: A.S.

DEC. 2019 - NTS