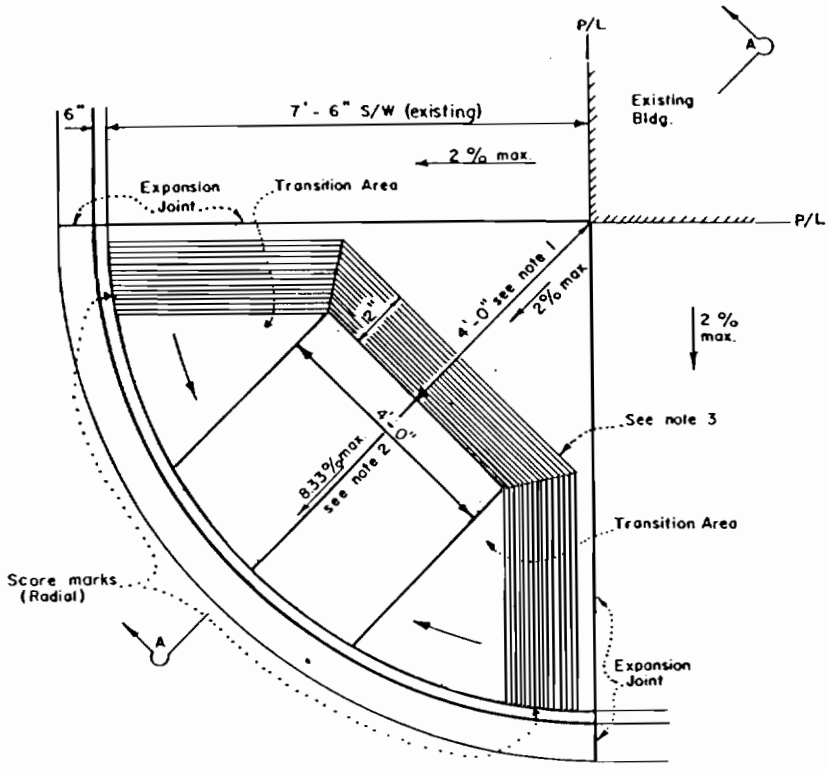

RETROFITS– 8' radius minimum, when adding a Wheelchair Ramp to an existing facility.

NOTES

1. Where the 4' platform is not feasible, the width may be decreased to 3'.
2. Ramp grade may be increased to a maximum of 11.1%. (Nevertheless, grade must be made as flat as possible.)
3. The ramp shall have a 12" wide border with 1/4" grooves approximately 3/4" o.c.
4. Refer to Notes no's 1, 2, 3, 4, 6, 8, 10 AND Section A-A and Grooving Detail of Standard Drawing No. 111.

CITY OF UKIAH			
WHEELCHAIR RAMP DETAIL (RETROFITS)			
Scale: NO SCALE	Drawn By: ML	Approved By:	Drawing No. 112
Date: 6-12-95	Revised: 3/98		