


NOTES:

1. EACH STRUCTURE SHALL HAVE AN INDIVIDUAL LATERAL FROM THE BUILDING TO THE COLLECTOR MAIN.
2. SEWER LATERAL SHALL BE A MINIMUM 4" DIAMETER UNLESS OTHERWISE APPROVED BY THE BUILDING INSPECTOR, AND OF THE FOLLOWING MATERIAL:
 - A. CAST IRON PIPE
 - B. PVC, SDR 35 (ASTM D-3034)
 - C. ACP, CLASS 2400
 - D. ABS, SCH. 40
 OR APPROVED EQUIVALENT.
3. MINIMUM SLOPE OF LATERAL 1/4" PER FT., UNLESS OTHERWISE SPECIFICALLY APPROVED BY THE BUILDING INSPECTOR, IN WHICH CASE THE SLOPE SHALL BE NO LESS THAN 1/8" PER FT.
4. BACKFILL LATERAL TRENCH PER "TRENCH DETAIL" AND STD. DRW. NO. 210.
5. LIMITS OF INSPECTION:
 BUILDING INSPECTOR: FROM R.L TO AND THROUGHOUT THE BUILDING.
 UKIAH VALLEY SANITATION DISTRICT: CITY PUBLIC WORKS WILL INSPECT FROM R.L TO BUILDING.

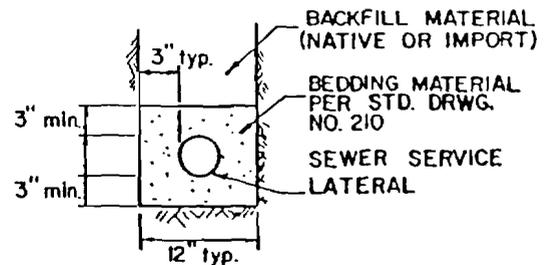

TRENCH DETAIL

CITY OF UKIAH

**SEWER SERVICE LATERAL
(PROPERTY LINE TO BUILDING)**

Scale: No Scale	Drawn By: ML	Approved By: 4/88	Drawing No.
Date: 3/17/87	Revised:	R. Pedersen	213