

CHRISTY B-9


BOX & LID (or approved equal)

JONES J-1963 W

JONES J-1975 W

ANGLE METER STOP

(or approved equal) (SEE NOTE 2)

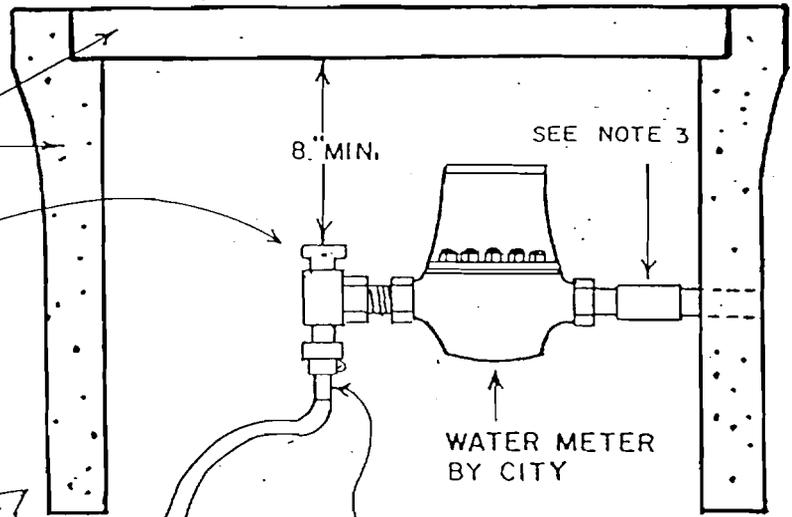

8" MIN.

SEE NOTE 3



WATER METER BY CITY

J-2805 (or approved equal)

WESTFLEX P.E. 3408 C.T.S.
(NO SUBSTITUTION) (1" MINIMUM FOR DUAL SERVICE)

JONES J-1935 (or approved equal)

JONES J-996 (or approved equal)

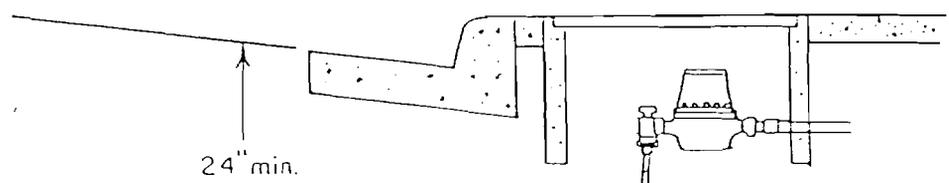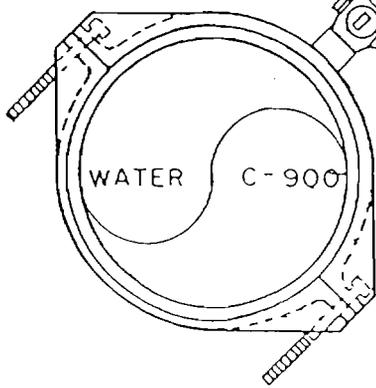

24" min.

1 1/2" and 2" SERVICE, INSTALL
JONES J-2611 COMPRESSION TO
COMPRESSION 90° ELBOW w/JONES
J-2805 STAINLESS STEEL LINERS
(or approved equal)


NOTES

1. ALL WATER MATERIAL TO MEET OR EXCEED A.W.W.A. SPECIFICATIONS.
2. STAINLESS STEEL LINERS FOR USE WITH PLASTIC SERVICE PIPE ARE REQUIRED.
3. CITY ORDINANCE NO. 478 REQUIRES HOMEOWNER TO PROVIDE A SUITABLE VALVE AS CLOSE TO THE METER AS POSSIBLE.

CITY OF UKIAH			
TYPICAL WATER SERVICE			
3/4 INCH MIN./2 INCH MAX.			
Scale: NONE	Drawn By: TM	Approved By:	Drawing No.
Date: MAY '90	Revised: 5-96	<i>Robert B. ...</i>	0301

THRUST BLOCK BEARING AREAS - SQUARE FEET

<u>PIPE DIA.</u>	<u>TEE</u>	<u>90° BEND</u>	<u>PLUG</u>	<u>VALVE</u>	<u>45° BEND</u>	<u>22 1/2° BEND</u>
6"	6	9	6	4	5	2
8"	11	16	11	7	8	4

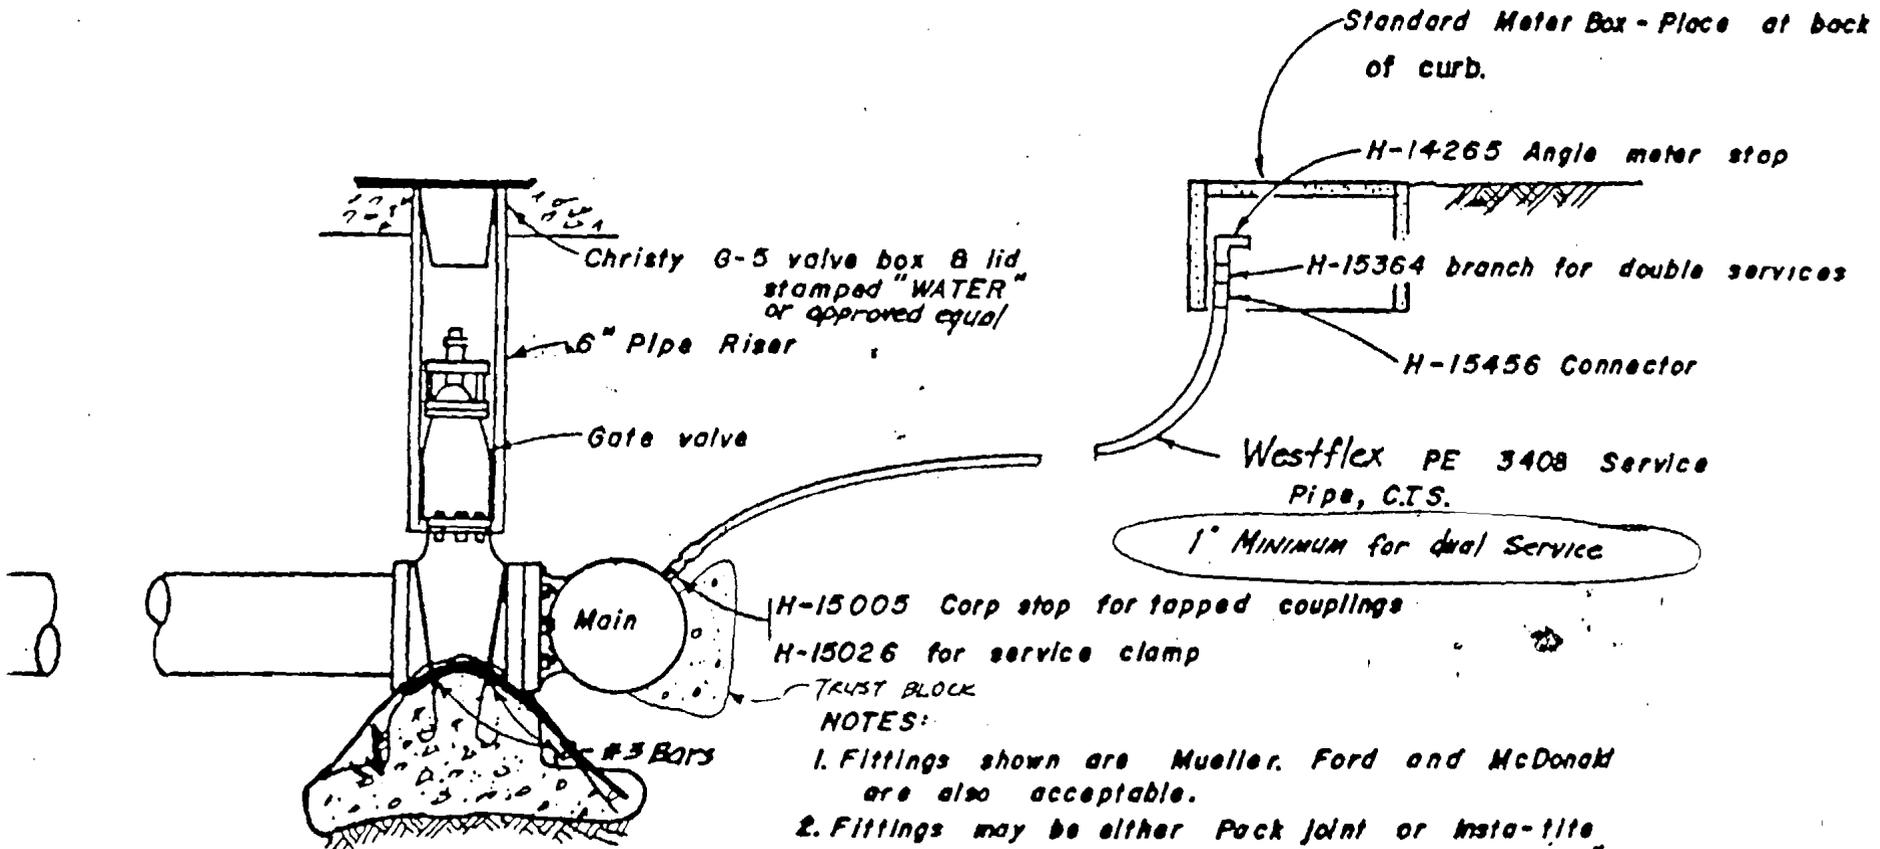

H-15005 Corp stop for tapped couplings
 H-15026 for service clamp

TRUST BLOCK
 NOTES:

1. Fittings shown are Mueller, Ford and McDonald are also acceptable.
2. Fittings may be either Pack joint or Insta-tite.
3. Minimum cover for service line in street is 24"
4. Use either double strap service clamp or tapped coupling at services.
5. P.E. fittings must use inserts for stiffness.
6. Use trust blocks at all tees, bends, reducers, etc.