


GATE VALVE: AMERICAN DARLING CRS OR APPROVED EQUAL. REFER TO STD. DRG. 307 FOR CONSTRUCTION DETAILS.

VALVE BOX: CHRISTY G5, or approved equal.

FIRE HYDRANT: Specify two(2) 2-1/2" hose outlets and one(1) 4-1/2" steamer outlet when ordering. Use the following types: JONES J-3760, RICH NO. 76 or equals specifically approved.

NOTES

1. WHEN HYDRANT IS AT STREET CORNER, PLACE 14" - 18" INSIDE CURB RETURN.
2. FOR LOCATION IN PLANTER STRIP, CENTER F.H. IN 4" CONCRETE SLAB, 48" L x WIDTH OF STRIP.
3. APPLY A SINGLE, FULL-STRENGTH COAT OF PAINT TO ENTIRE HYDRANT; PREVENT PAINT FROM ENTERING THREADS AT OUTLET CAPS. USE GLOSS WHITE OIL BASE PAINT: FULLER OBRIEN (Stock #312-91), RUST-O-LEUM (Stock # 7692), STYLETONE (Stock #819-01P) OR EQUAL.
4. PROVIDE FIRE HYDRANT LOCATION MARKER SPECIFICATION 6-03.4 OF TRAFFIC MANUAL, STATE OF CALIFORNIA DOT.
5. DEADEND RUNS UP TO 200 FEET MAY BE 6" PIPE WITH APPROVAL OF FIRE DEPARTMENT; RUNS IN EXCESS OF 200' TO BE 8" PIPE.

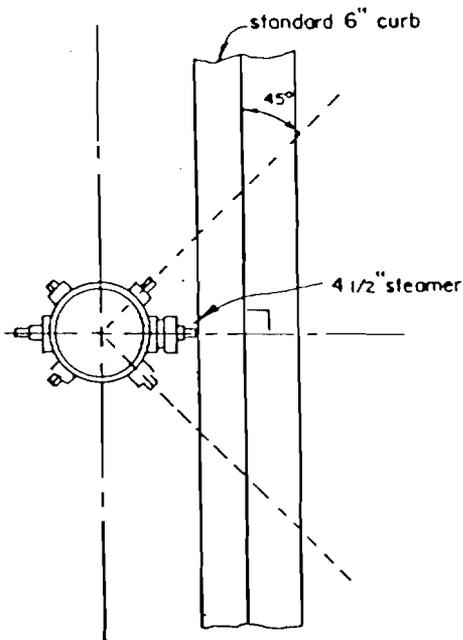

PLAN VIEW

CITY OF UKIAH

FIRE HYDRANT LATERAL

SCALE: NO SCALE	DRAWN: ML	APPROVED: <i>[Signature]</i>	DRAWING NO. 305
DATE: 3/98	REVISED: LJV		